



TYBOX 63

www.deltadore.com

Important product
information (24)




	2 x 1,5V LR03 - AAA Alkaline	230V~, 50 Hz +/- 10% 0,5 VA
Class		
	868 MHz (EN 300 220) 100 m	
	8 max.	
	/	5 A max., 230V~ Cos φ = 1 (Type 1.C)
°C	-5°C / +40°C	
	80 x 103 x 25 mm	55 x 170 x 25 mm
IP		IP 40
CE	R&TTE 1999/5/CE	

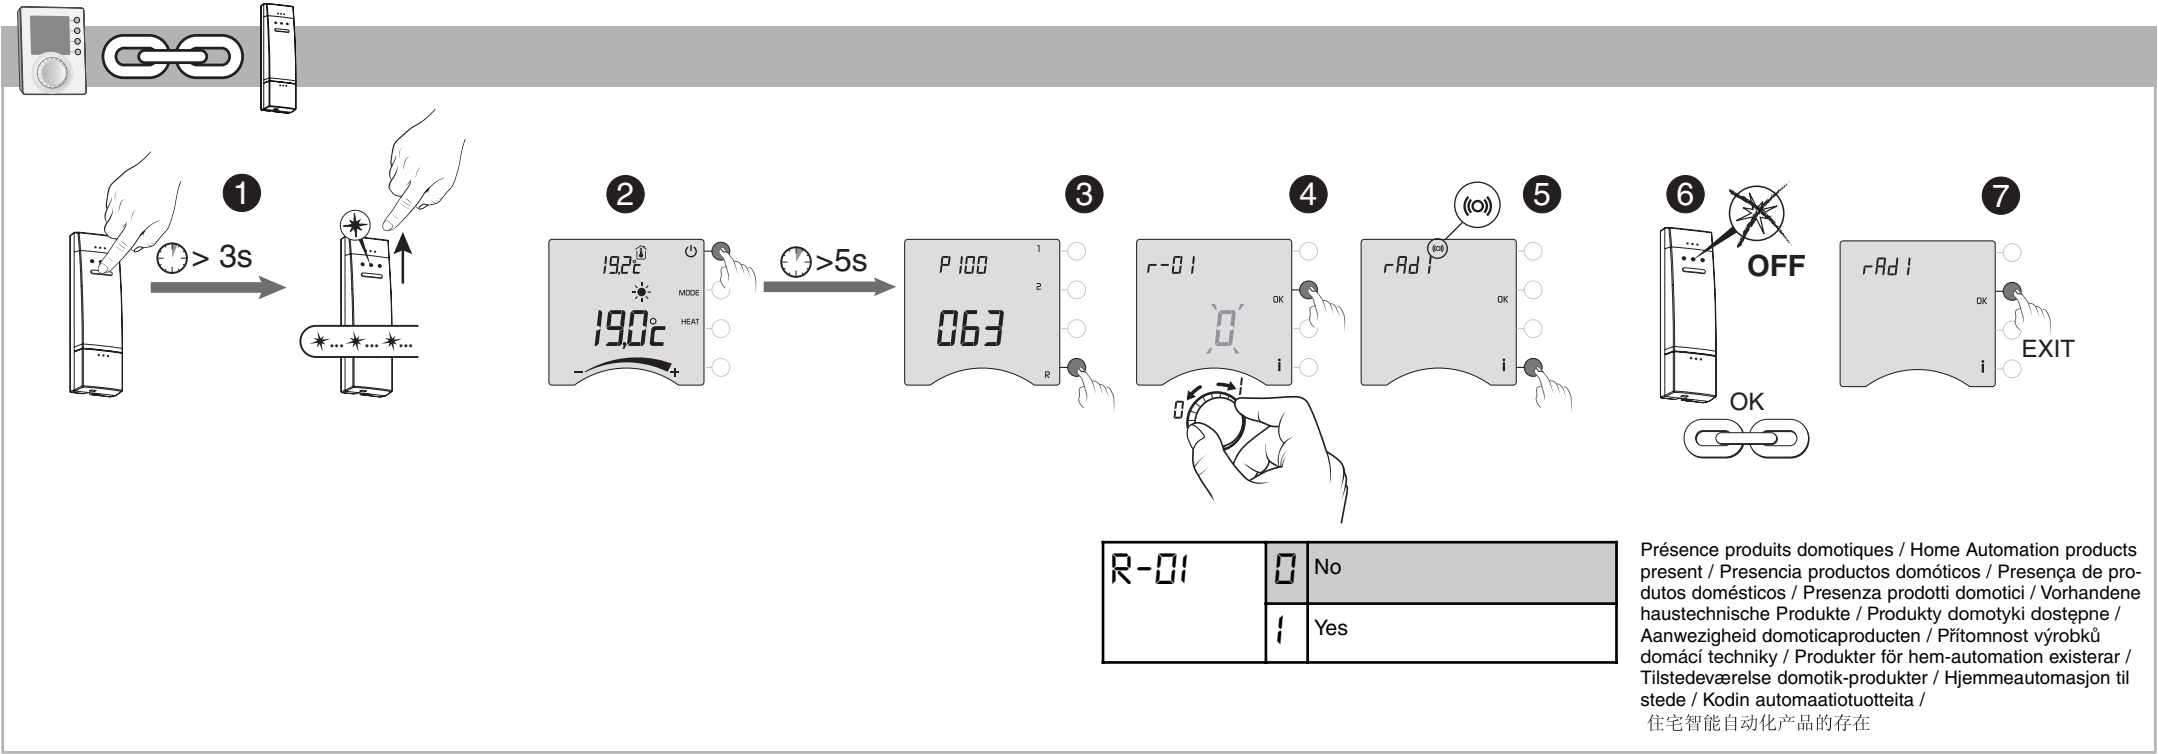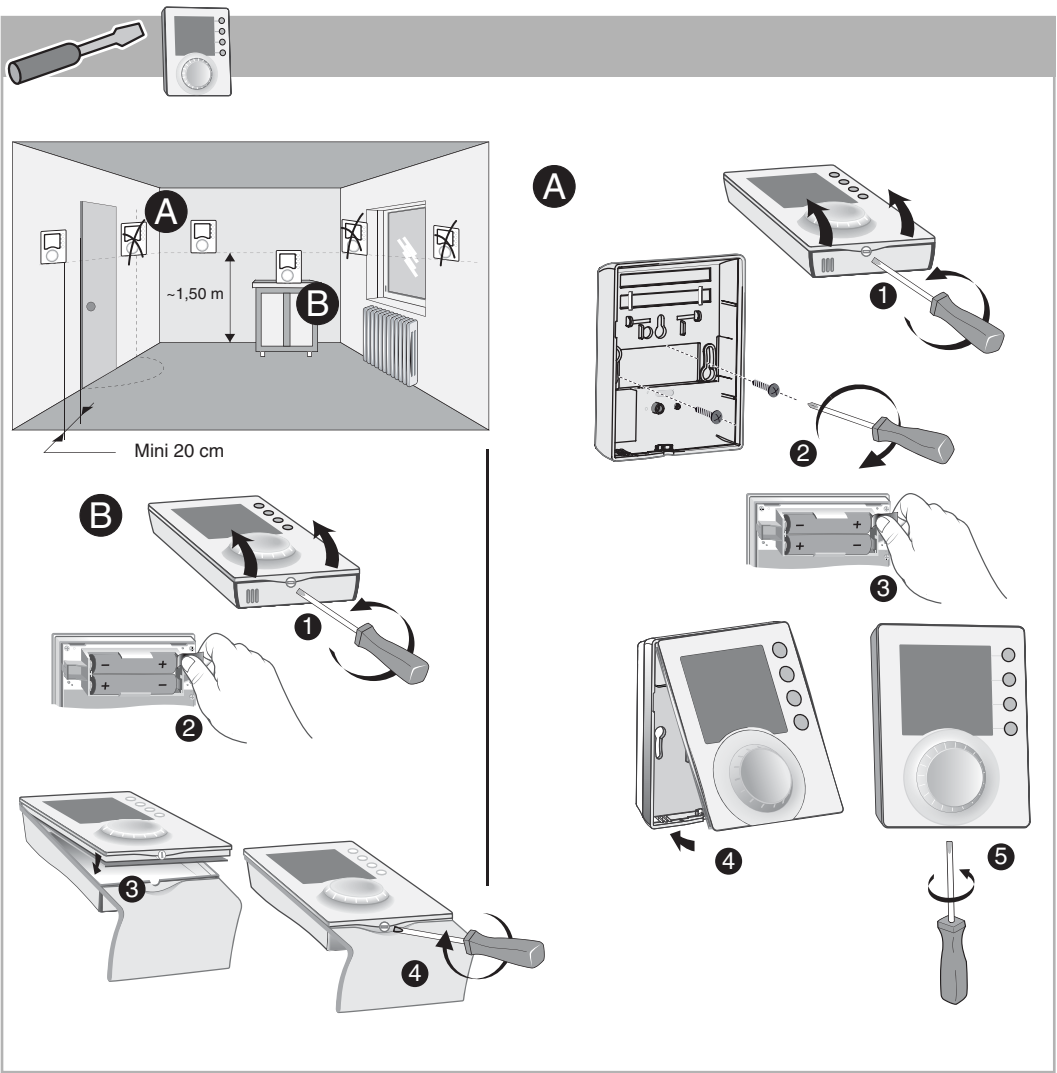

R-01	0	No
	1	Yes

Présence produits domotiques / Home Automation products
present / Presencia productos domóticos / Presença de pro-
dutos domésticos / Presenza prodotti domotici / Vorhandene
haustechnische Produkte / Produkty domotyki dostępne /
Aanwezigheid domoticaproducten / Přítomnost výrobků
domácí techniky / Produkter för hem-automation existerar /
Tilstedeværelse domotik-produkter / Hjemmeautomasjon til
stede / Kodin automaattituotteita /
住宅智能化自动化产品的存在


MENU 1

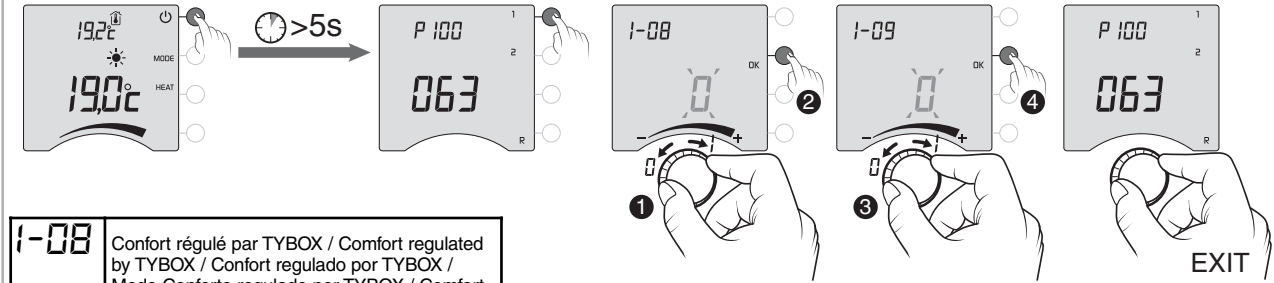

1-08	Confort réglé par TYBOX / Comfort regulated by TYBOX / Confort regulado por TYBOX / Modo Conforto regulado por TYBOX / Comfort regolato mediante TYBOX / Komfoteinstellung über den TYBOX / Regulacja komfortu przez TYBOX / Comfort geregeld door TYBOX / Komfort regulovaný TYBOX / Komfort reglerad av TYBOX / Komfort regleret af TYBOX / Komfort regulert av TYBOX / Lämpötilan sää- tely TYBOXilla / 通过TYBOX调节的舒适状态
1-09	Anti-grippage / Anti-seizing / Antigripado / Antigripagem / Antigrippaggio / Festlaufschutz / System zapobiegający blokowaniu się pompy / Antiblokkering / Proti zadření / Anti- friktion / Anti-rivning / Antiblokkering / Kiertovesipumpun kiinnijuttumisen esto / 防卡

1-08	0	Yes
	1	No

1-09	0	No
	1	Yes

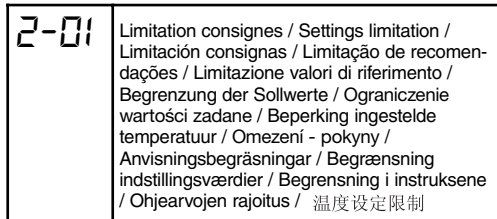

2-02	Correction température mesurée / Measured temperature correction / Corrección temperatura medida / Correção da temperatura medida / Correzione temperatura misurata / Korrektur der gemessenen Temperatur / Korekta zmierzonej temperatury / Aanpassen gemeten temperatuur / Korekce měřené teploty / Uppmätt temperaturkorrigering / Korrektion målt temperatur / Mitatun lämpötilan korjaus / 测量出的温度的校正
------	---

2-08	Base de temps de régulation / Regulation time base / Base de tiempos de regulación / Base de tempo de regulação / Base di tempo di regolazione / Zeitbasis für die Einstellung / Podstawa czasu regulacji / Basis voor instel- lingstijd / Báze doby regulace / Bas för inställ- ningstid / Tidsbasis for regulering / Tidsenhet for regulering / Lämmönsäätelyn aikayksikkö / 调节时基
------	---

2-01	0	  : 5°C <  > 30°C  : 5°C <  > 15°C
	1	 - 3°C <  > +3°C

2-08	15	Minutes
	30	Minutes
	45	Minutes
	60	Minutes

2-02 - 5°C <  > +5°C

